



中国认可
国际互认
检测
TESTING
CNAS L1449

检 验 报 告

TEST REPORT

报告编号: JC2017ZD0565

样品名称: 井干式木刻楞墙体
Sample Name

委托单位: 满洲里凯润木业有限公司
Applicant

检验类别: 委托检验
Test Type

国家建筑防火产品安全质量监督检验中心

National Center for Safety Quality Supervision and Testing of Fire-proof Building Products



国家建筑防火产品安全质量监督检验中心

检 验 报 告 (TEST REPORT)



报告编号№: JC2017ZD0565

第1页, 共3页

委托单位 Applicant	满洲里凯润木业有限公司	检验类别 Test Type	委托检验
受检单位 Inspected Entity	满洲里凯润木业有限公司	委托日期 Consign Date	2017年09月21日
工程名称及使用部位 Engineering Name and Application Part	——	来样日期 Accept Date	2017年09月21日
样品名称 Sample Name	井干式木刻楞墙体	样品数量 Sample Quantity	10m ²
型号/规格 Type/Specification	4000mm×2500mm×140mm	样品等级 Grade	——
生产单位 Manufacturer	满洲里凯润木业有限公司	样品状态 Sample State	板状
生产日期/批号 Production Date/Lot №	——	商标 Trade Mark	——
检验依据 Ref Documents	GB/T19889.3-2005《声学 建筑和建筑构件隔声测量第3部分: 建筑构件空气隔声的实验室测量》 GB/T 50121-2005《建筑隔声评价标准》		
检验项目 Test Item	空气声隔声量		
检验结论 Test Conclusion	经GB/T19889.3-2005和GB/T 50121-2005检验, 该井干式木刻楞墙体的空气声计权隔声量为$R_w(C; C_{tr})=39(-1; -3)$ dB。 签发日期: 2017年09月29日 Issued by (Stamp)		
附注 Remarks	1. 本检验结果仅对来样负责; 2. 空气声隔声量试样墙体由委托方安装, 木方拼接, 水泥砂浆堵缝。		

批 准:
Approved by:审 核:
Inspected by:主 检:
Tested by:

国家建筑防火产品安全质量监督检验中心

检 验 报 告 (TEST REPORT)

报告编号№: JC2017ZD0565

第2页, 共3页

序号	检验项目	标准要求	检验结果	单项判定
1	空气声隔声量, dB	——	Rw (C; Ctr) =39 (-1; -3)	——

检测地址: 北京市石景山区金顶北路69号;
联系电话: 4000330789、010-88724984。

(本页以下空白)


检 验 报 告 (TEST REPORT)

报告编号№: JC2017ZD0565

第3页, 共3页

1/3 倍频程中心频率隔声特性曲线

1/3 倍频程中心频率的隔声量

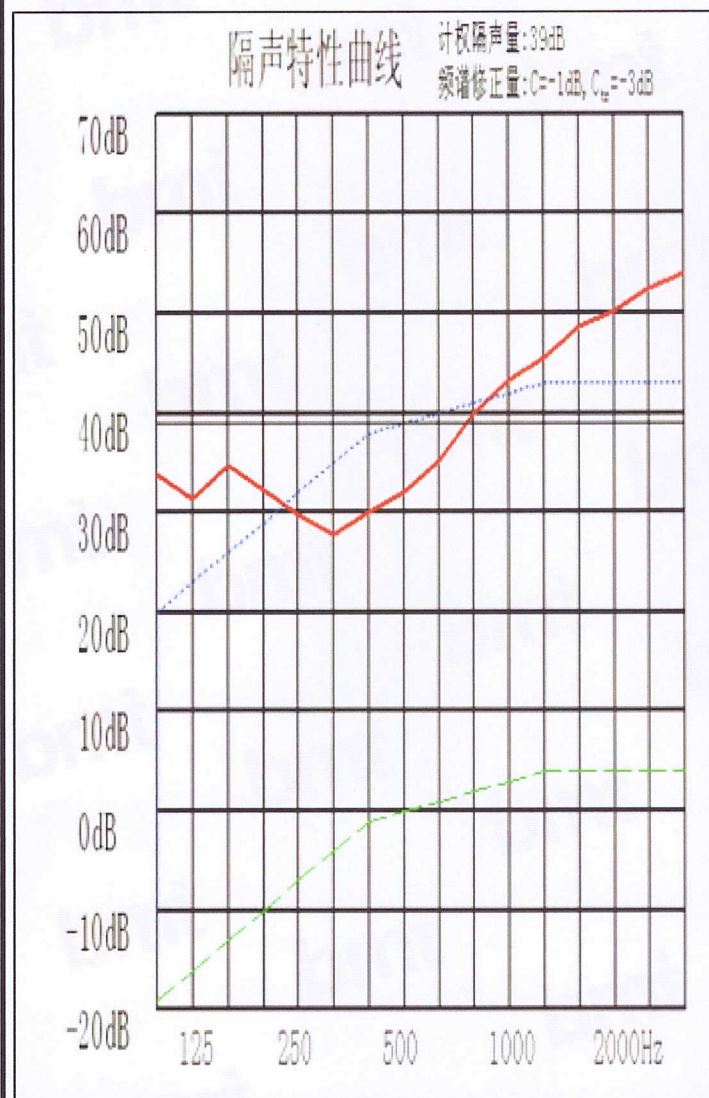

1/3 倍频程中心频率 (Hz)	隔声量, dB
100Hz	33.8
125Hz	31.4
160Hz	34.7
200Hz	32.4
250Hz	29.8
315Hz	27.8
400Hz	30.1
500Hz	32.1
630Hz	35.2
800Hz	40
1000Hz	43.2
1250Hz	45.4
1600Hz	48.7
2000Hz	50.3
2500Hz	52.4
3150Hz	54
计权隔声量 R_w	39
频谱修正量 C	-1
频谱修正量 C_{tr}	-3

***** 结 束 *****

注意事项
NOTICE

1.报告无“检验检测专用章”或检验单位公章、骑缝章无效。

Test report is invalid without the "special seal for test report" or that of test department and perforated rider stamp on it.

2.复制报告未重新加盖“检验检测专用章”或检验单位公章无效。

Duplication of test report is invalid without the "special seal for test report" or that of test department re-stamped on it.

3.报告无主检、审核、批准签字无效。

Test report is invalid without the signatures of the persons for chief test, verification and approval.

4.报告涂改无效。


Test report is invalid if altered.

5.对检验报告若有异议，应于收到报告之日起十五日内向检验单位提出。

Any dissidence about the test report should be brought forward to the test department within 15 days from the date of receiving the test report.

6.一般情况，委托检验仅对来样负责。

In general, for entrusted tests the responsibilities are undertaken for the delivered samples only.

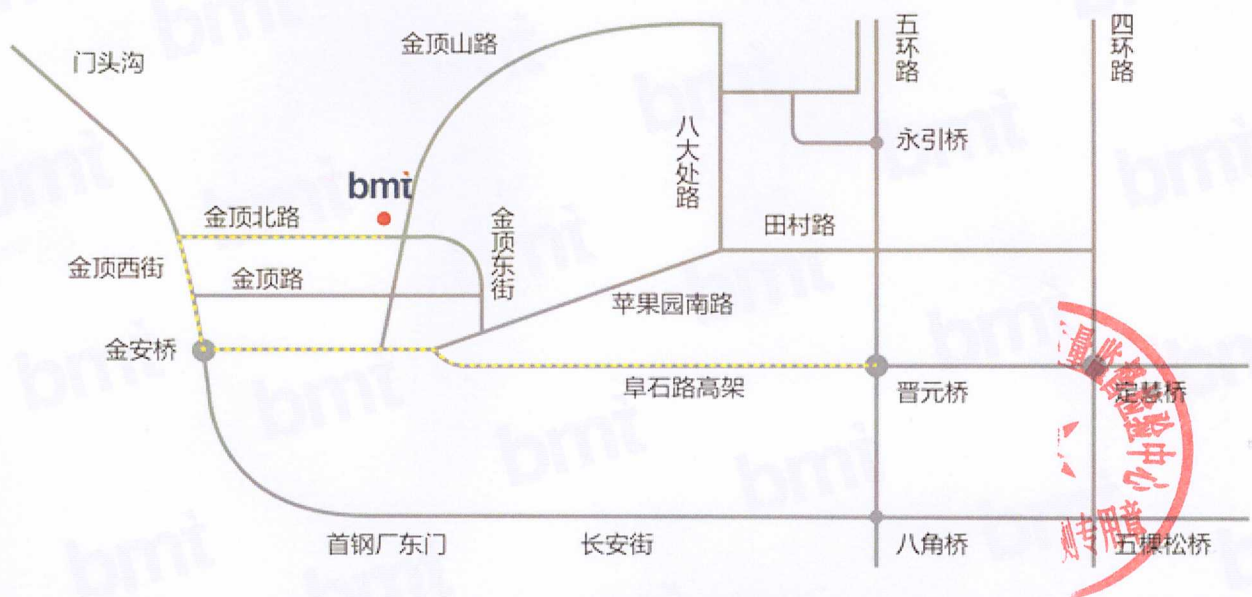

路线备注:沿阜石路高架向西行驶,见金顶西街出口进入辅路,金安桥下右转,第二个丁字路口(第一个红绿灯)右转,直行 600 米路北。



地址：北京市石景山区金顶北路69号(100041)

Add:No.69 JinDing North Road ,Shijingshan District,Beijing,China 100041

网址(Web) : www.bmtbj.cn

电话(Tel):010-88724984 88749821

传真(Fax):010-88715189

客服热线：400-0330-789